





# TRUCKEE SANITARY DISTRICT RECOMMENDED BACKWATER VALVE INSTALLATION EXHIBIT

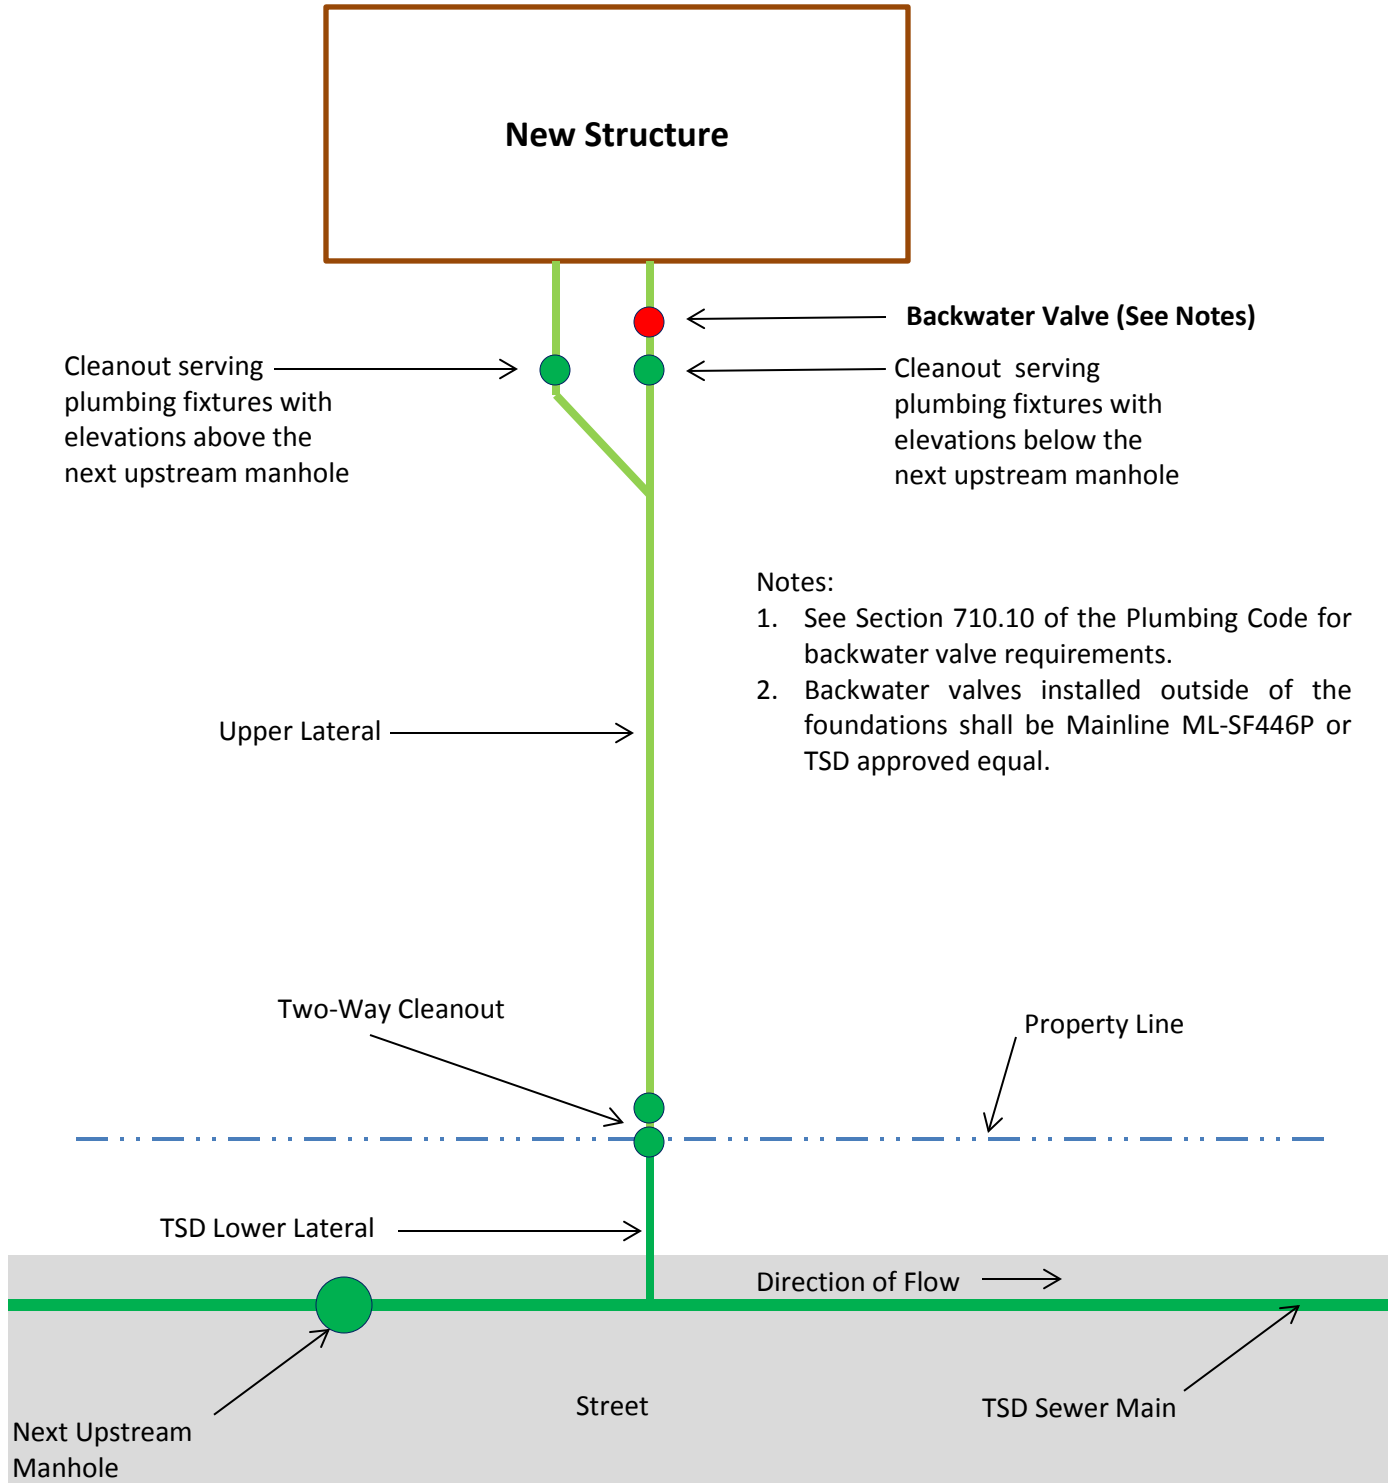

### Notes:

1. See Section 710.10 of the Plumbing Code for backwater valve requirements.
2. Backwater valves installed outside of the foundations shall be Mainline ML-SF446P or TSD approved equal.

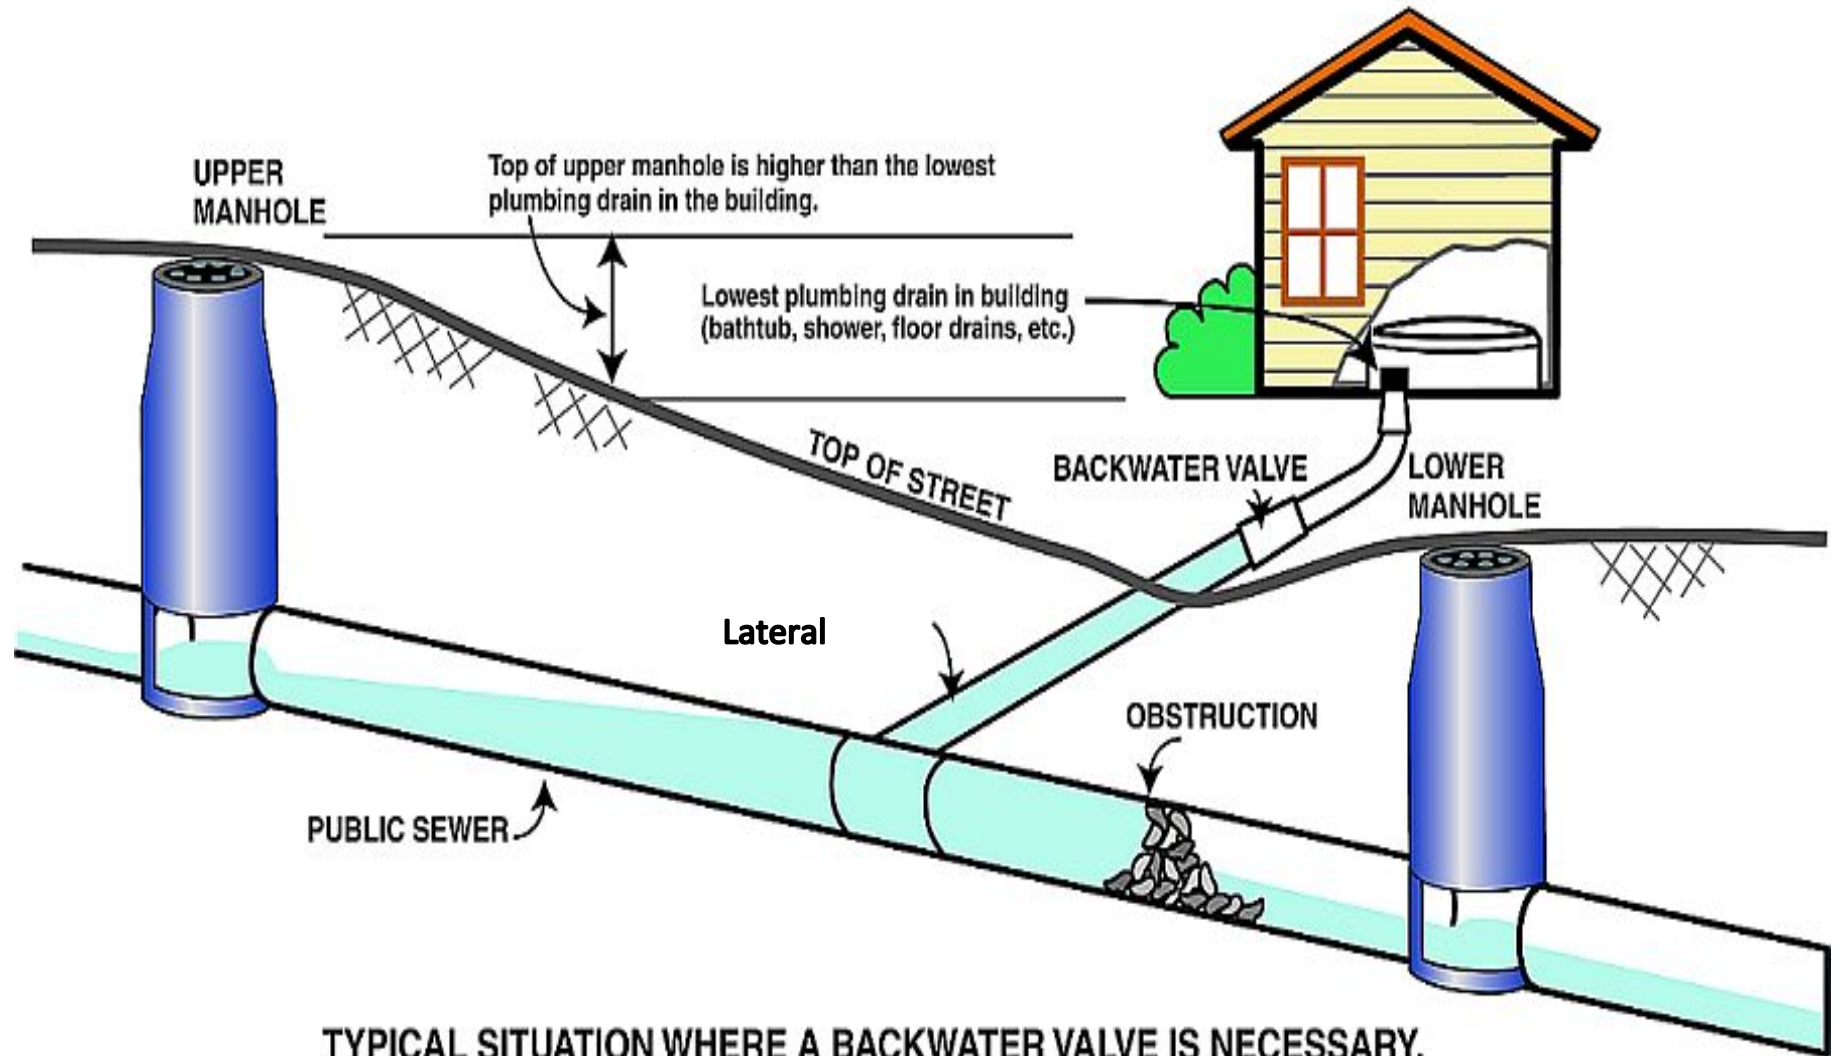

**TYPICAL SITUATION WHERE A BACKWATER VALVE IS NECESSARY.**

# PLUMBING CODE

## 710.0 Drainage of Fixtures Located Below the Next Upstream Manhole or Below the Main Sewer Level.

710.1 Where a fixture is installed on a floor level that is lower than the next upstream manhole cover of the public or private sewer, serving such drainage piping, shall be protected from backflow of sewage by installing an approved type of backwater valve. Fixtures on floor levels above such elevation shall not discharge through the backwater valve. Cleanouts for drains that pass through a backwater valve shall be clearly identified with a permanent label stating "backwater valve downstream".

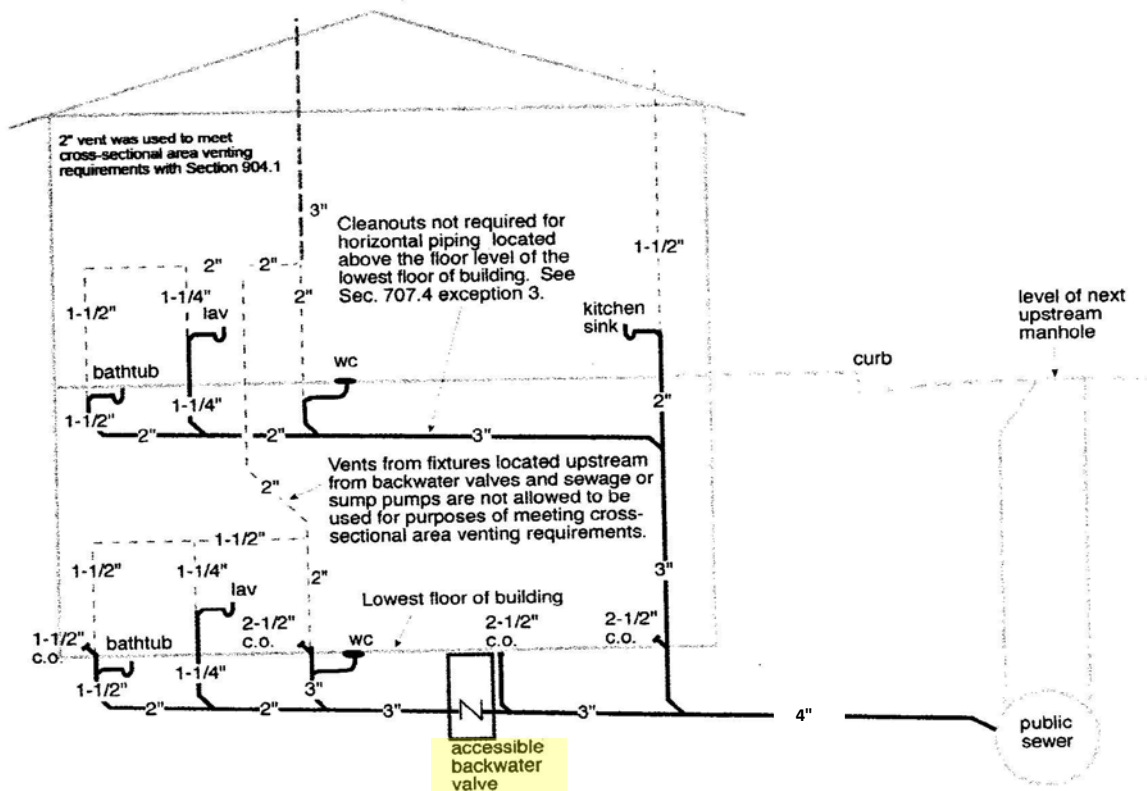


Figure 7-23  
Fixtures Located Below Upstream Manhole Cover