



Courtesy of the City of Santa Barbara



TRUCKEE SANITARY DISTRICT RECOMMENDED BACKWATER VALVE INSTALLATION EXHIBIT

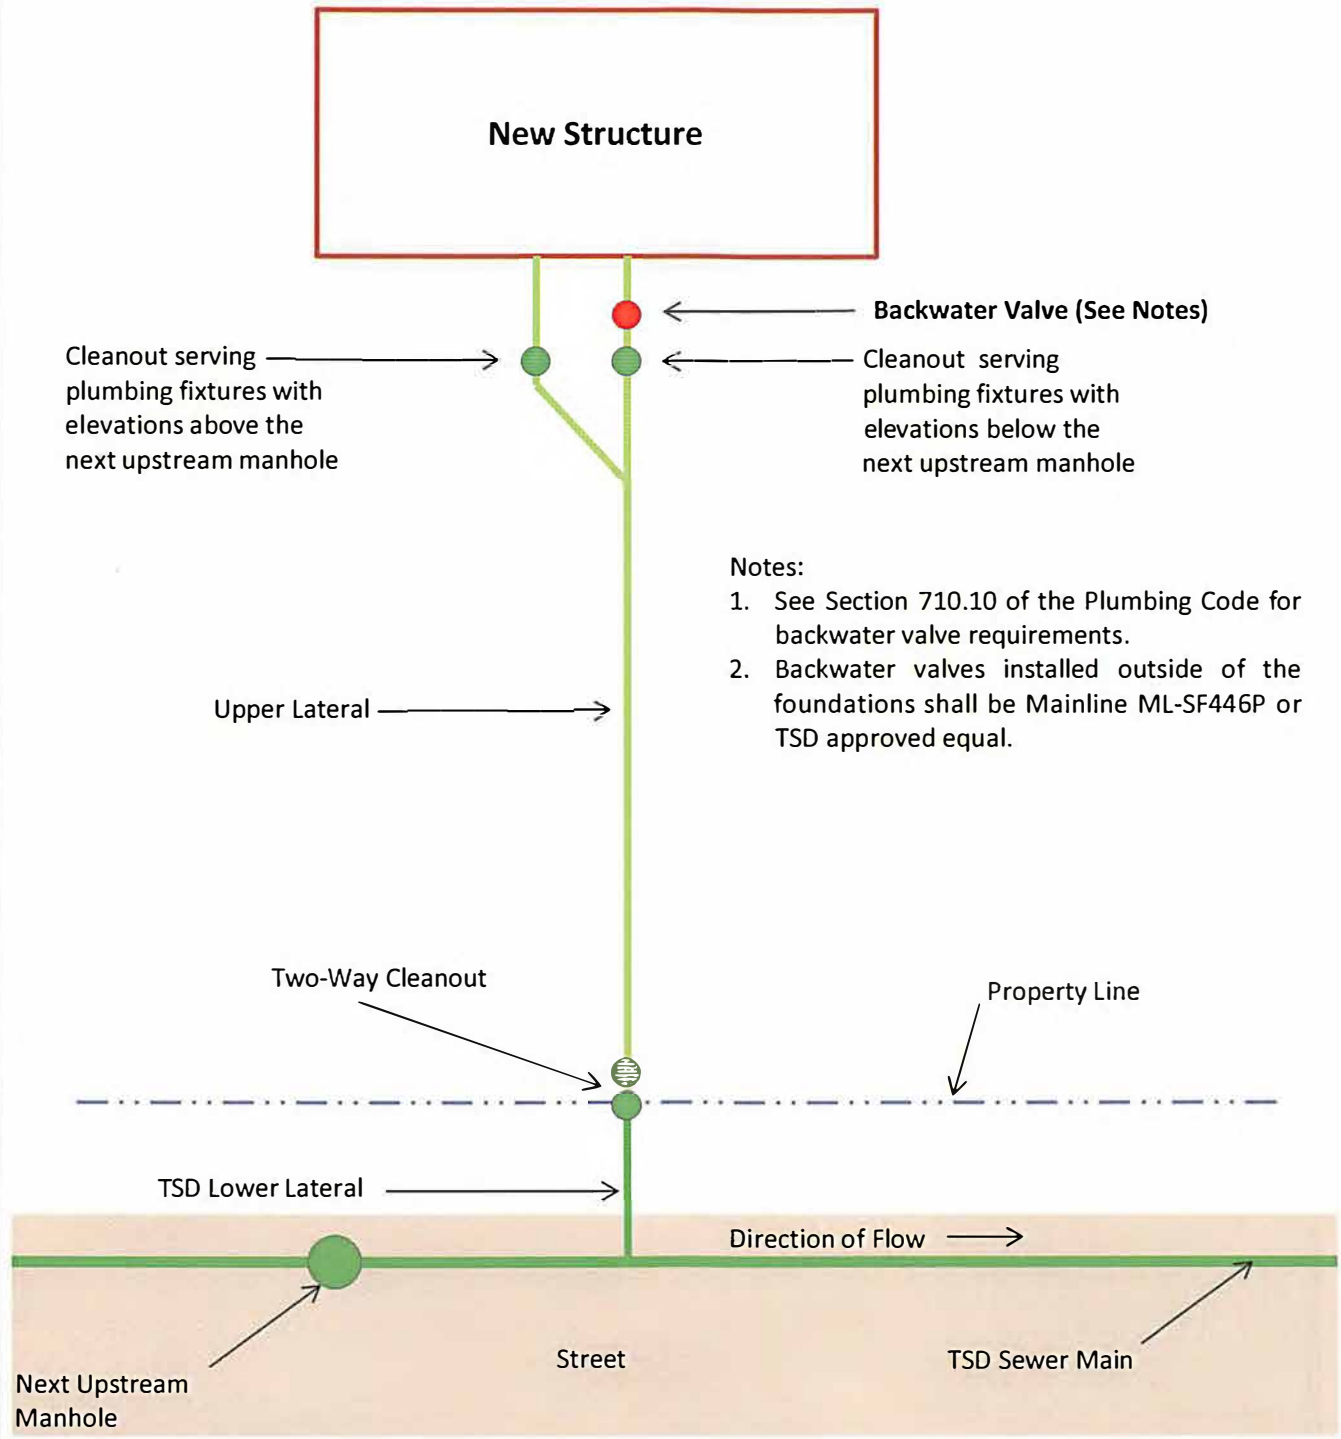

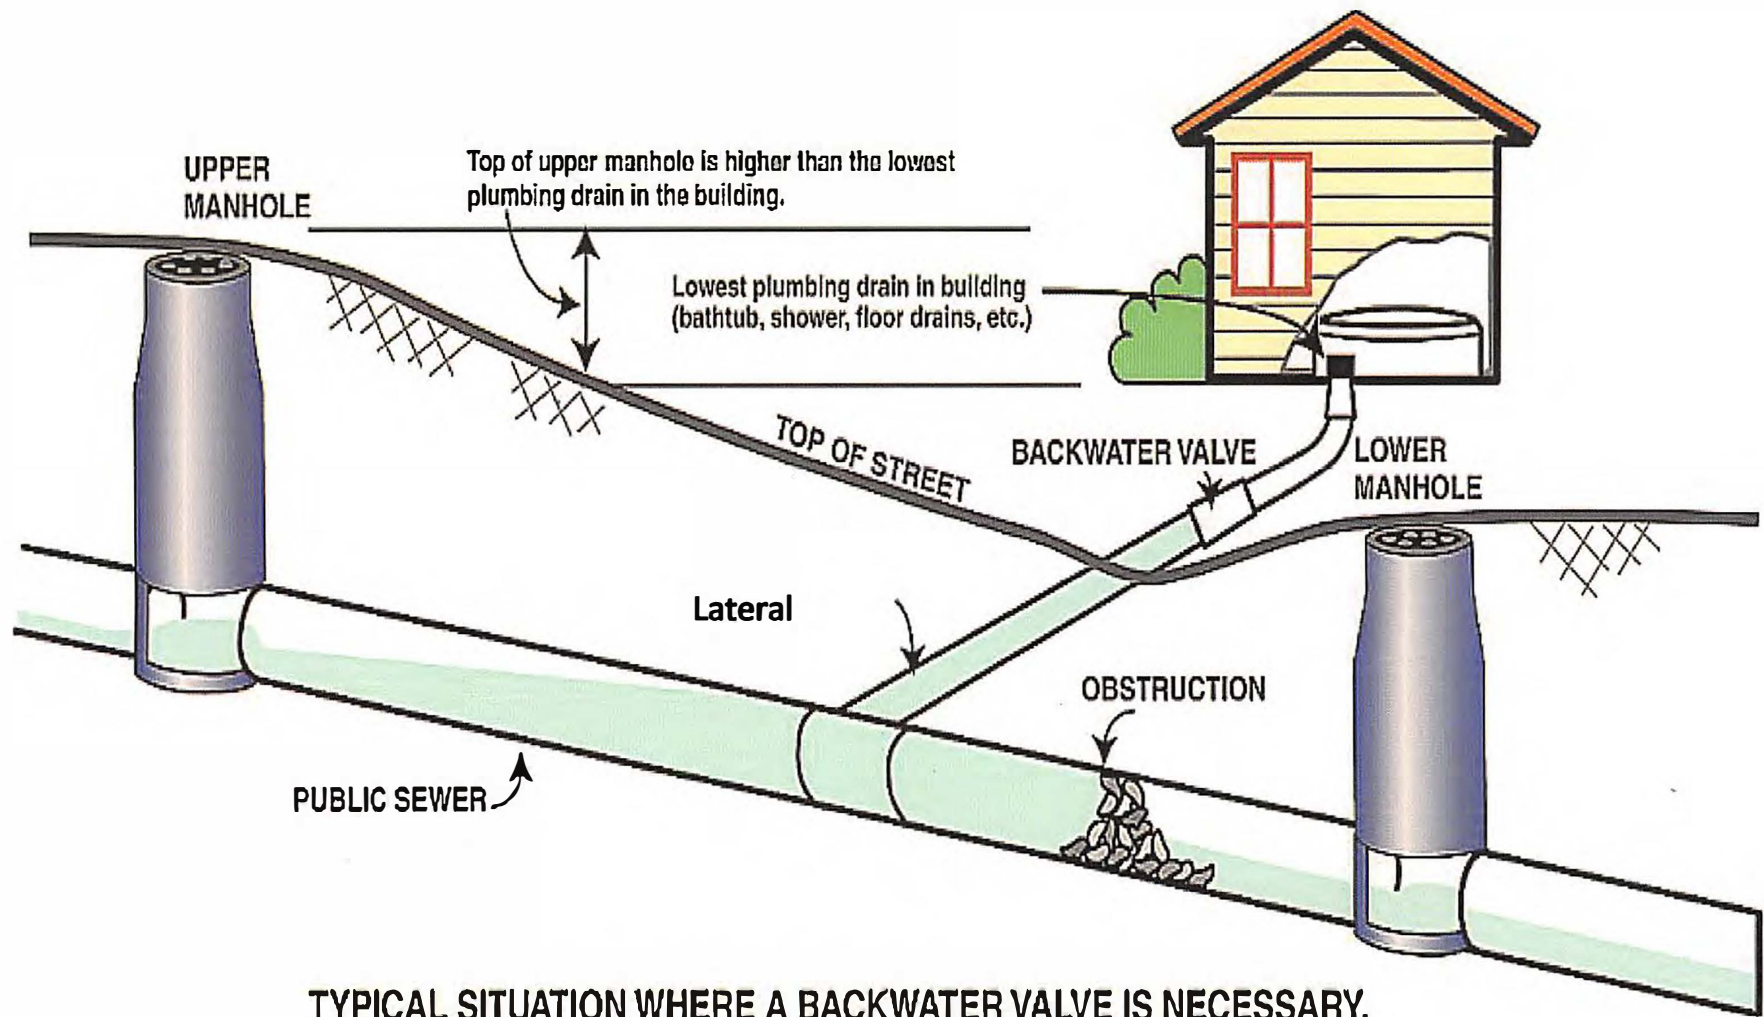

PLUMBING CODE

710.0 Drainage of Fixtures Located Below the Next Upstream Manhole or Below the Main Sewer Level.

710.1 Where a fixture is installed on a floor level that is lower than the next upstream manhole cover of the public or private sewer, serving such drainage piping, shall be protected from backflow of sewage by installing an approved type of backwater valve. Fixtures on floor levels above such elevation shall not discharge through the backwater valve. Cleanouts for drains that pass through a backwater valve shall be clearly identified with a permanent label stating "backwater valve downstream".

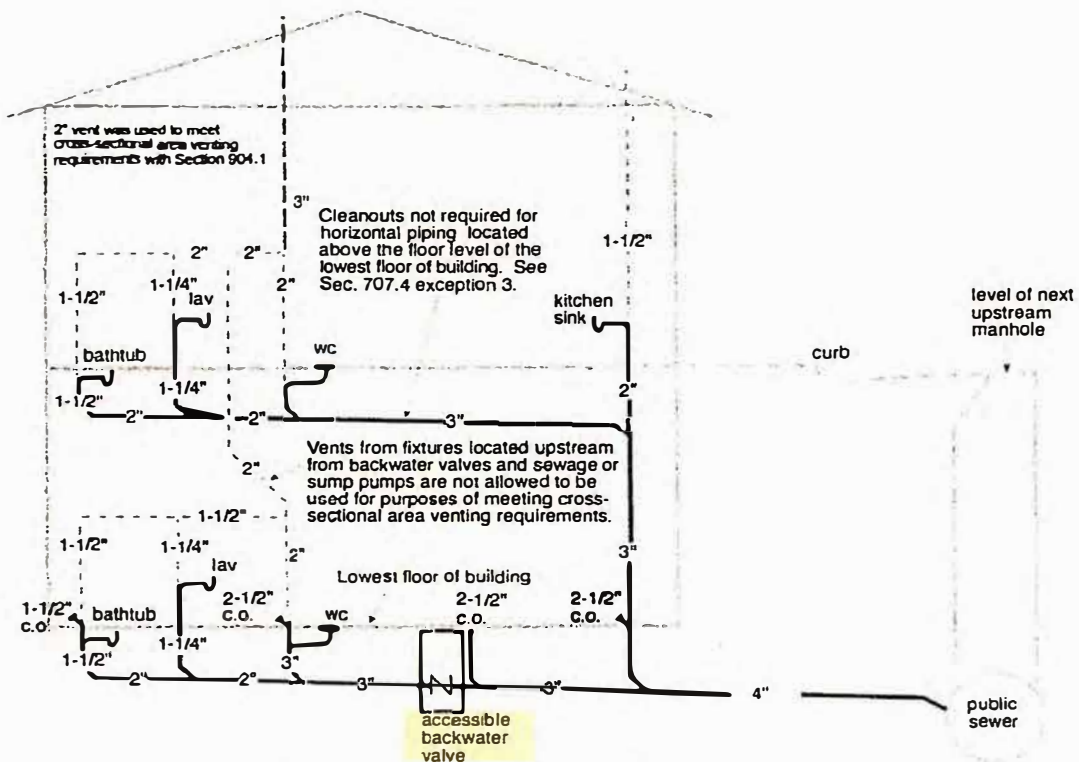


Figure 7-23
Fixtures Located Below Upstream Manhole Cover



12304 Joerger Drive • Truckee, California 96161-3312
Telephone: 530-587-3804 • Fax: 530-587-1340

Request for Exemption of Backwater Valve Device

PROPERTY INFORMATION		
Address of Property: _____		
Assessor's Parcel Number: _____	Lot #: _____	Unit #: _____
Owner's Name: _____		
Building Permit #: _____		
STATEMENT OF EXEMPTION		
I _____ (Name of Verifier) hereby certify that the following elevations (Print) have been surveyed on the above referenced property and that a Backwater Valve Device is not required: Uphill Manhole Rim Elevation: _____ Lowest Plumbing Fixture Rim Elevation: _____		
VERIFIER INFORMATION		
Business Name: _____	License Number: _____	
Mailing Address: _____		
Telephone Number: _____	Email Address: _____	
Request Date: _____	Signature of Verifier: _____	
	Title: _____	
TRUCKEE SANITARY DISTRICT RESPONSE		
Comments: _____		
Approved <input type="checkbox"/> Denied <input type="checkbox"/>		
District Representative Signature: _____		Date: _____